

This Page Is Inserted by IFW Operations  
and is not a part of the Official Record

## **BEST AVAILABLE IMAGES**

Defective images within this document are accurate representations of the original documents submitted by the applicant.

Defects in the images may include (but are not limited to):

- BLACK BORDERS
- TEXT CUT OFF AT TOP, BOTTOM OR SIDES
- FADED TEXT
- ILLEGIBLE TEXT
- SKEWED/SLANTED IMAGES
- COLORED PHOTOS
- BLACK OR VERY BLACK AND WHITE DARK PHOTOS
- GRAY SCALE DOCUMENTS

**IMAGES ARE BEST AVAILABLE COPY.**

**As rescanning documents *will not* correct images,  
please do not report the images to the  
Image Problem Mailbox.**



Fig. 3A

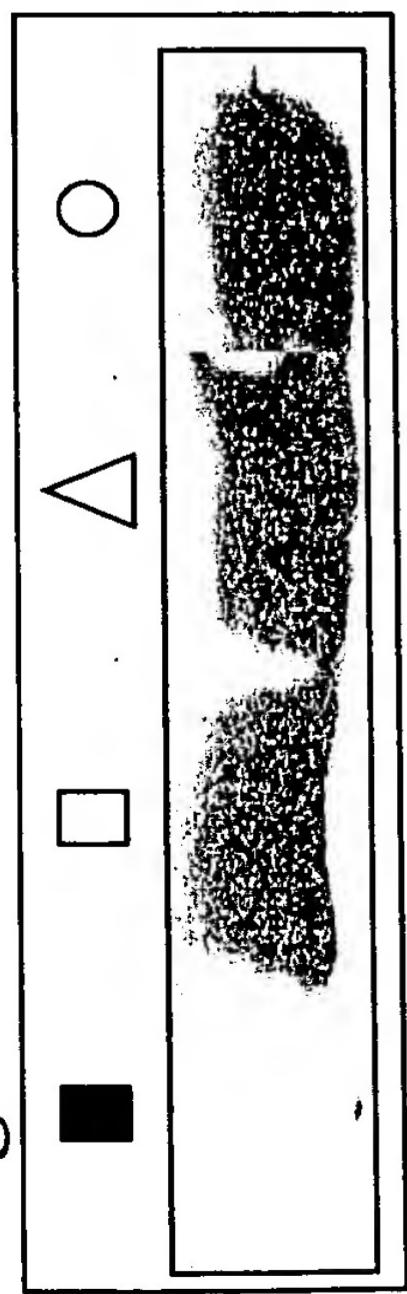


Fig. 3C

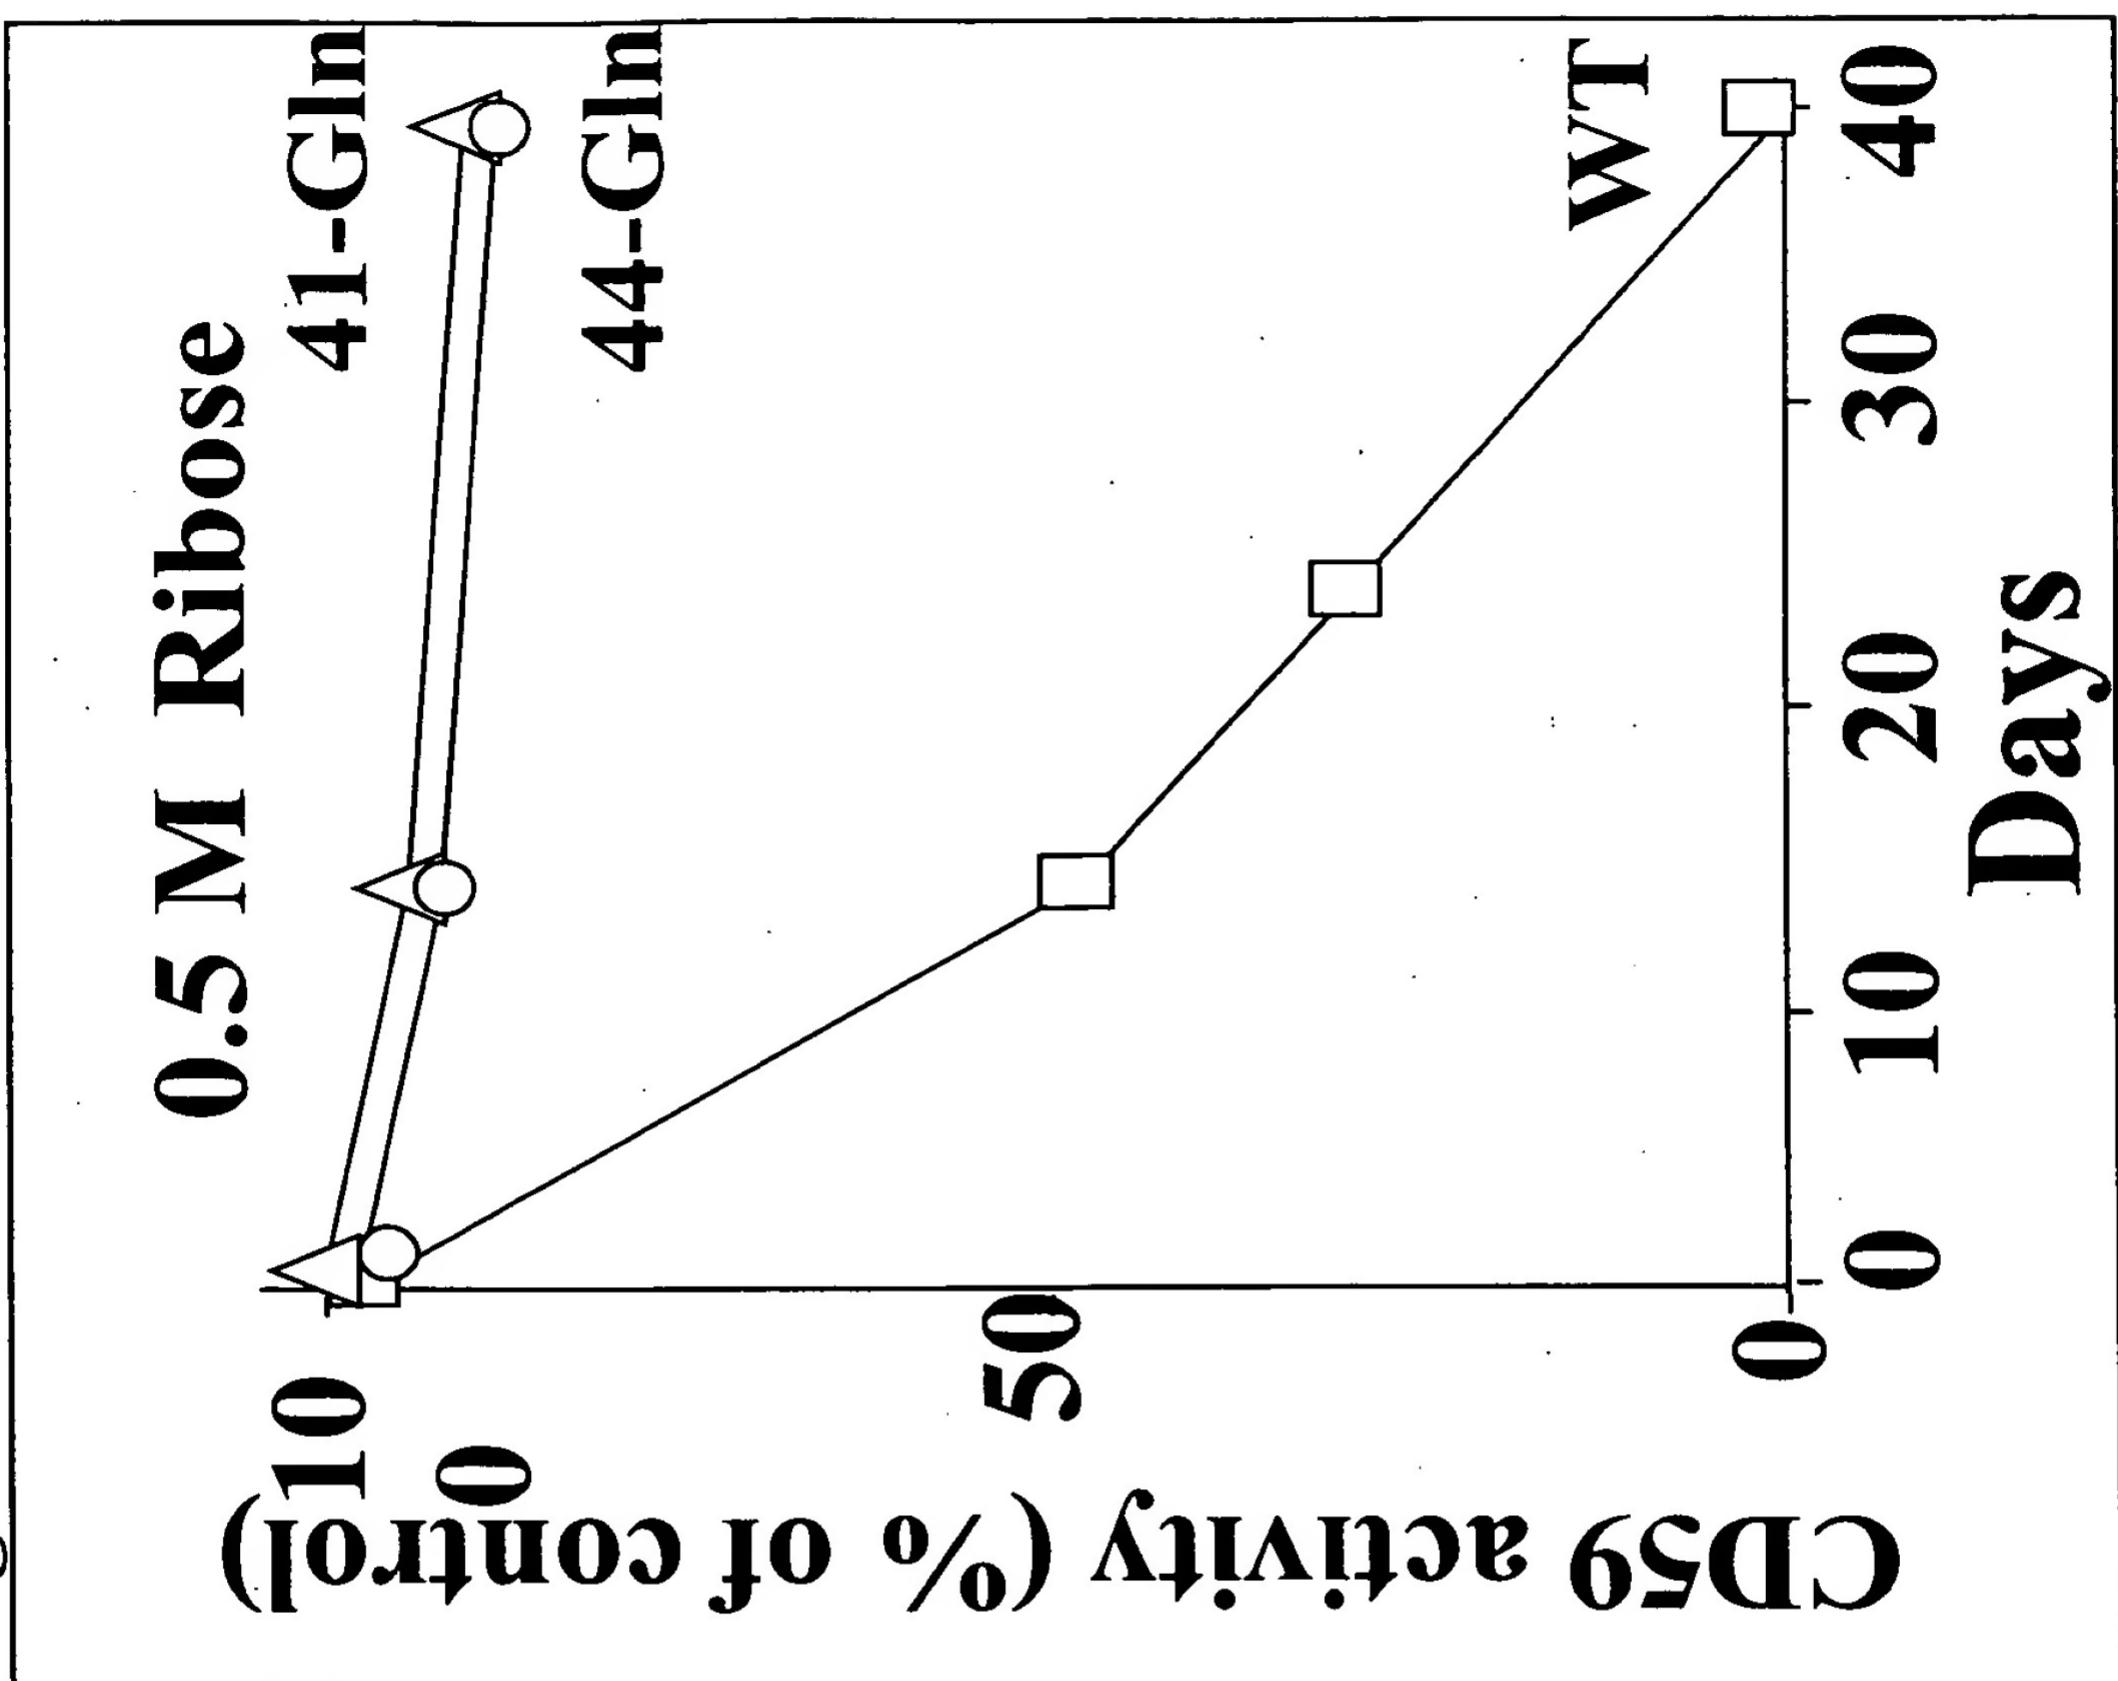
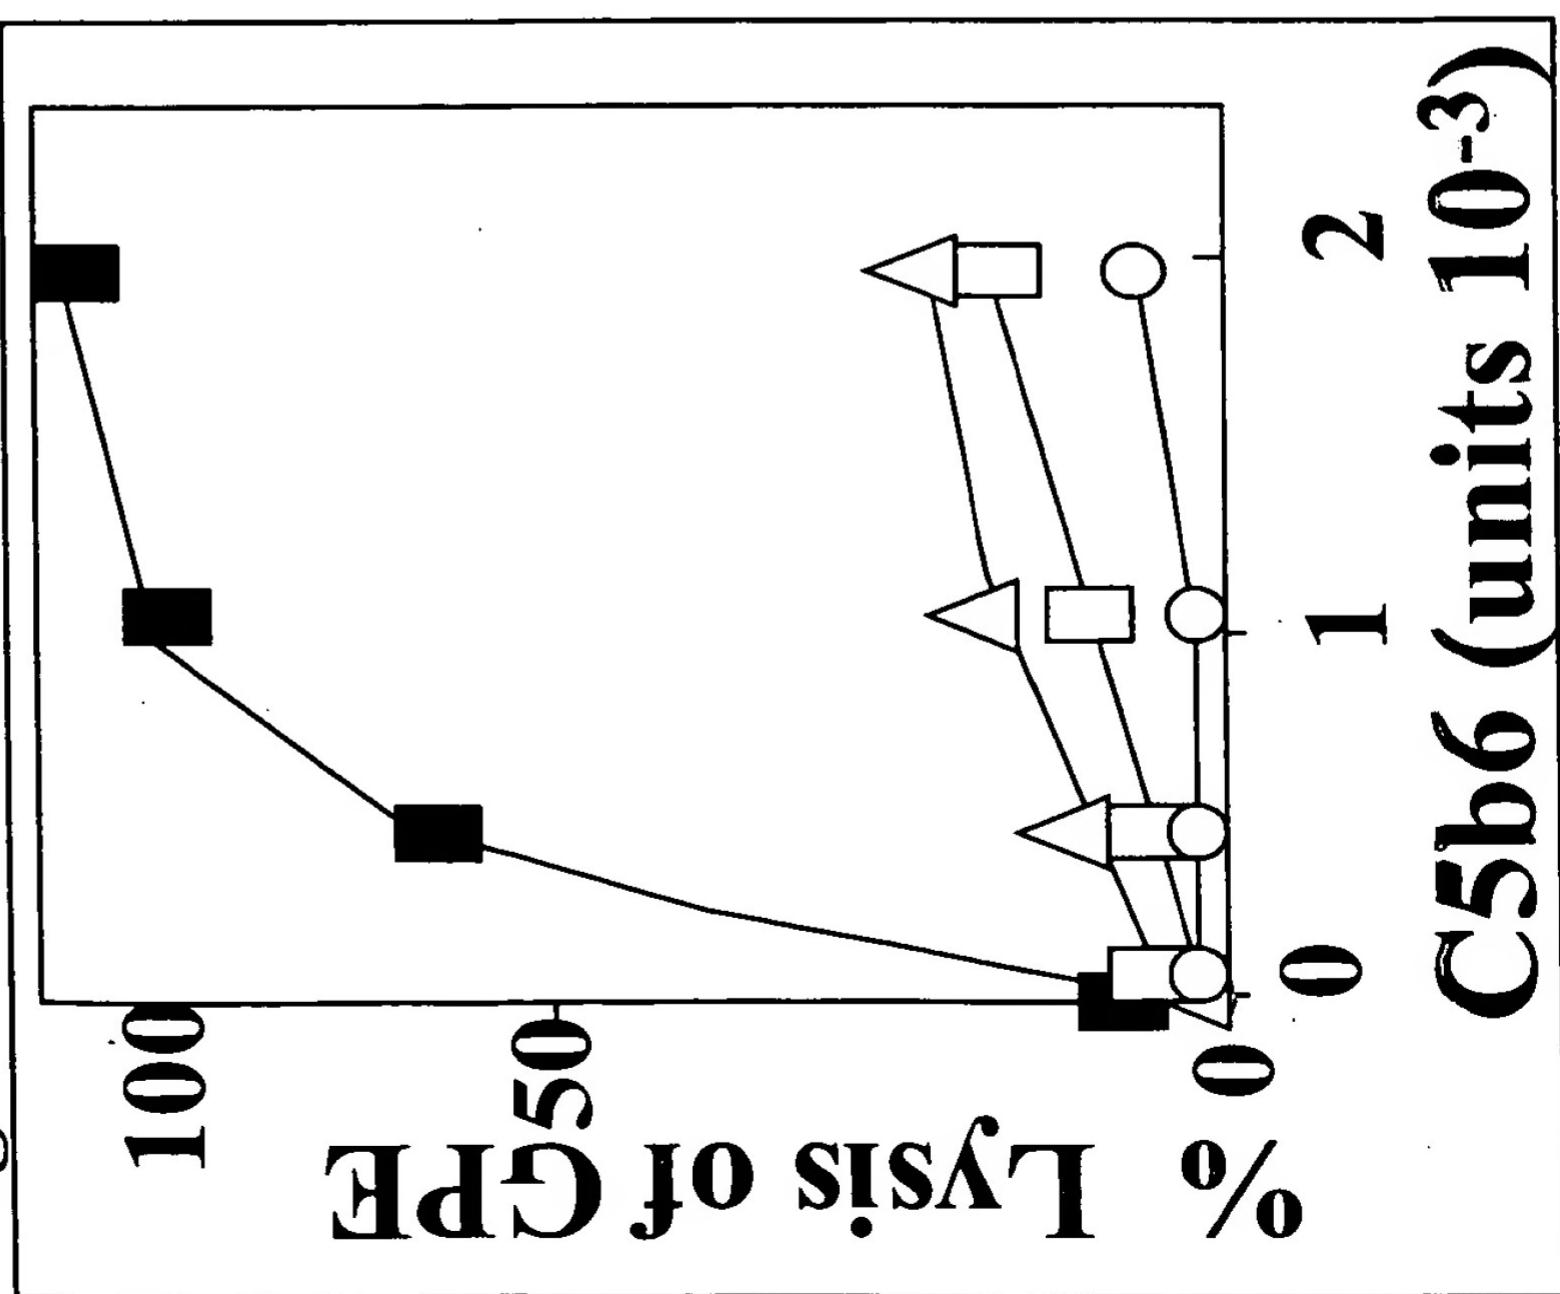
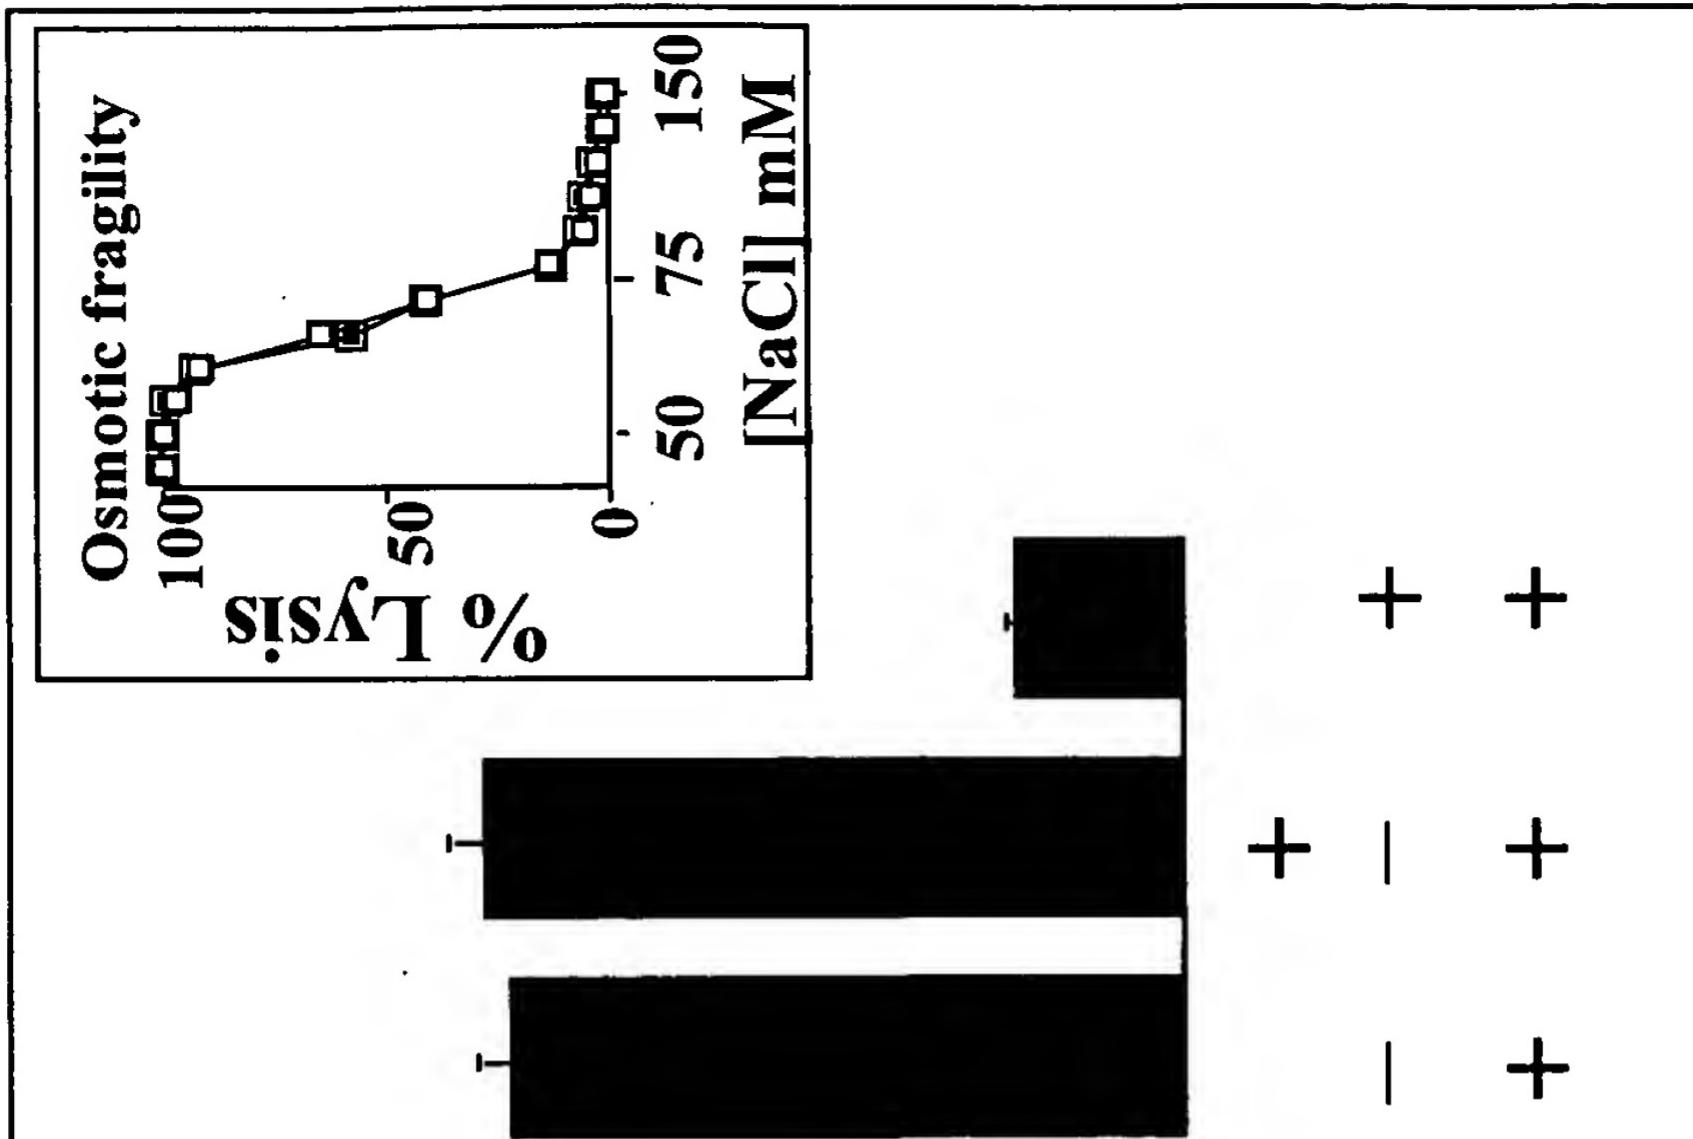
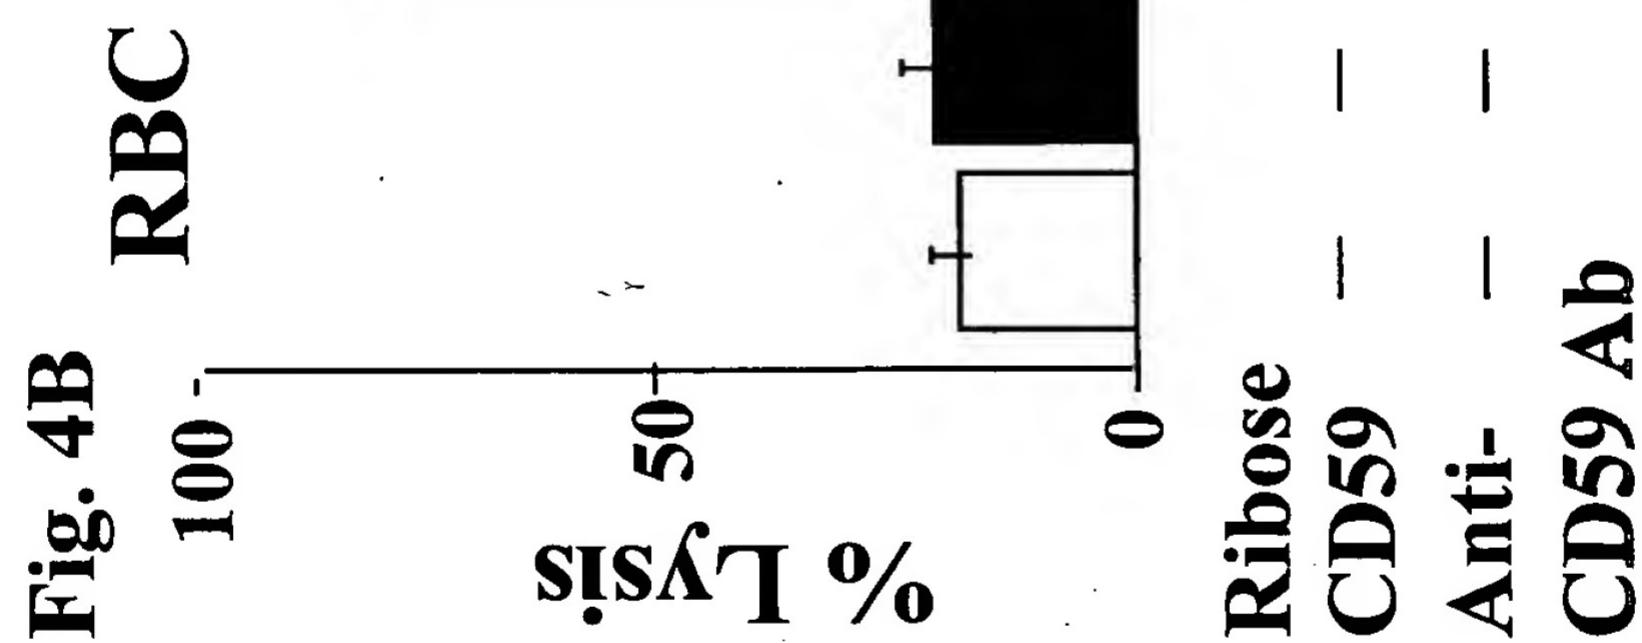
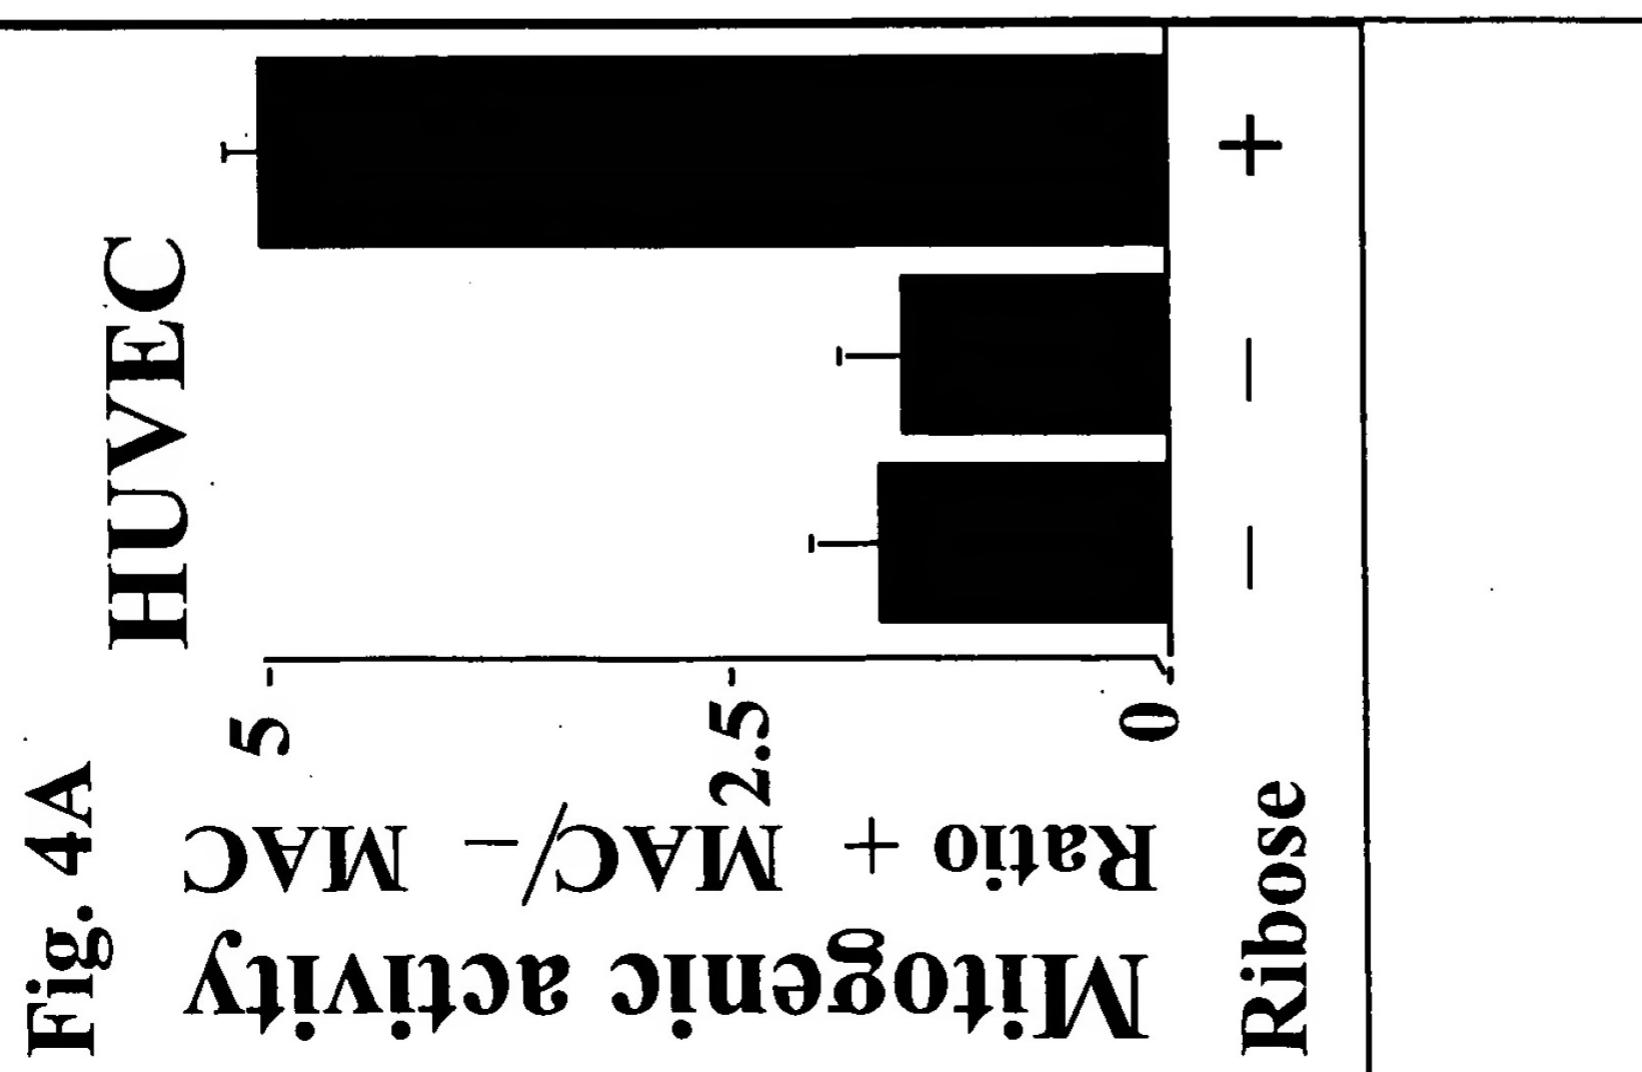
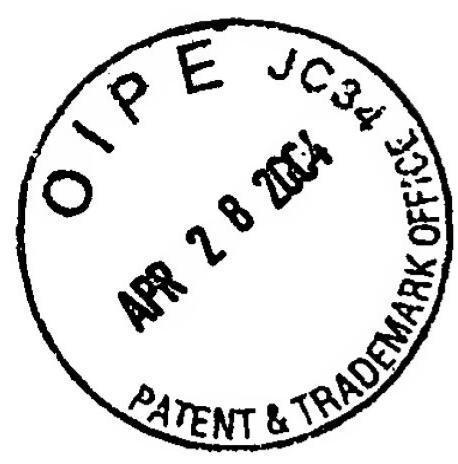


Fig. 3B





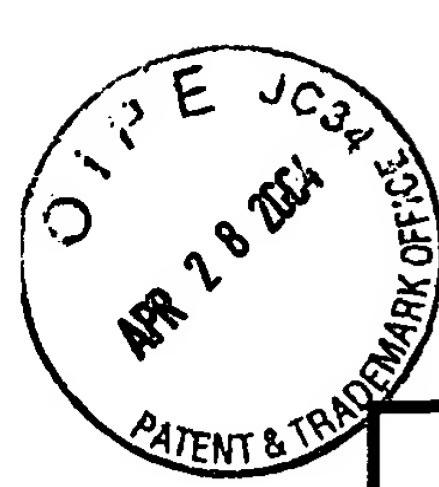


Fig. 5A

**Anti-CD59**

18.7 kd →



**Anti-hexitol - lysine**

18.7 kd →

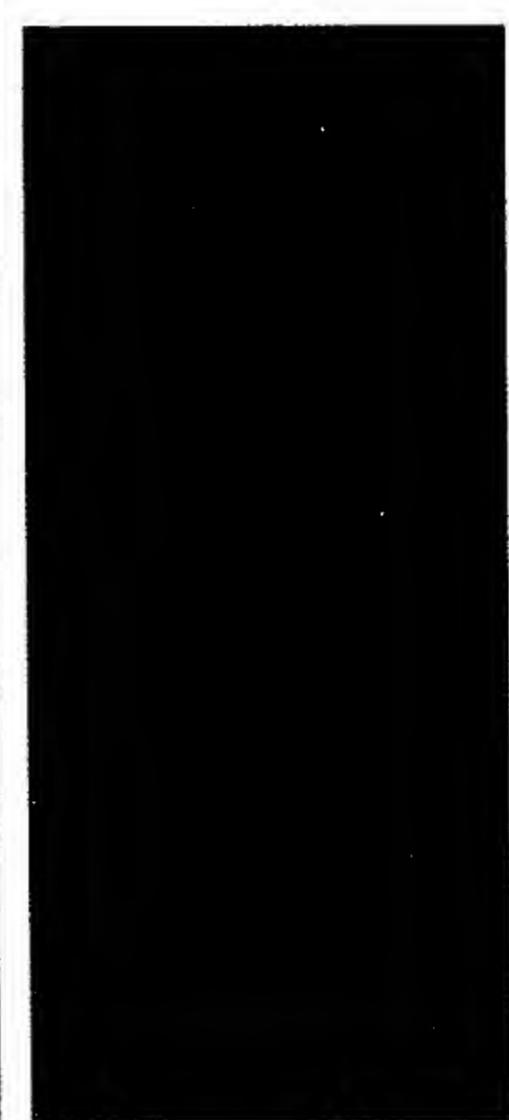


Fig. 5B

**Anti-hexitol  
lysine**

**Albumin**



**CD59**



**NG G**

Signal intensity ( $\times 10^{-3}$ )  
(upper/lower)       $\frac{99}{4} \frac{190}{150} \frac{145}{125} \frac{175}{3} \frac{199}{5}$

HbA1c levels (%)      3 11.5 8.5 3 4